





LEGEND:

- PROPOSED POLE AND FIXTURES
- ③ POLE NUMBER
- LC PROPOSED LIGHTING CONTROL CABINET
- H PROPOSED HANDHOLE
 - 32" x 19" x 18" DEEP FOR UP TO 10 CONDUITS
 - 36" x 24" x 18" DEEP FOR OVER 10 CONDUITS
- V PROPOSED CONCRETE VAULT WITH (4" x 4")
- PROPOSED UNDERGROUND RPVC CONDUIT
- PROPOSED UNDERGROUND 2" RPVC P.A. CONDUIT


GENERAL NOTES:

- REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- STUB OUT AND CAP 2" CONDUIT FROM EACH HANDHOLE FOR FUTURE USE.


①	Z/C (B6 & C3/C4) Z/C (A5/A6) Z/C (B5)
②	Z/C (C3/C4) Z/C (SCOREBOARD - EMPTY)
③	Z/C (C3/C4) Z/C (EMPTY)
④	Z/C (A5/A6 RECEIPT ON A6 & SECURITY LTG FIELD 3) Z/C (B5)
⑤	Z/C (A5/A4 RECEIPT ON A3 & SECURITY LTG FIELD 4) Z/C (B3/B4) Z/C (EMPTY)
⑥	Z/C (A5/A6 & SECURITY LTG FIELD 3) Z/C (B5) Z/C (EMPTY)
⑦	Z/C (A5/A4 RECEIPT ON A3 & SECURITY LTG FIELD 4) Z/C (B3/B4) Z/C (EMPTY)
⑧	Z/C (B3/B4) Z/C (EMPTY)
⑨	Z/C (A5/A4 & SECURITY LTG FIELD 4) Z/C (B3/B4) Z/C (EMPTY)
⑩	Z/C (A1/A2, B1 & B2) Z/C (RECEIPT ON A1, SECURITY LTG FIELD 1) Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (SCOREBOARD - EMPTY)
⑪	Z/C (A1/A2, B1 & B2) Z/C (RECEIPT ON A1, SECURITY LTG FIELD 1) Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (SCOREBOARD - EMPTY)
⑫	Z/C (A1/A2, B1 & B2) Z/C (RECEIPT ON A1, SECURITY LTG FIELD 1) Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (EMPTY)
⑬	Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (EMPTY)
⑭	Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (EMPTY)
⑮	Z/C (A7/A8 & B7/B8) Z/C (RECEIPT ON A8, SECURITY LTG FIELD 2) Z/C (EMPTY)
⑯	Z/C (A1/A2 & B2) Z/C (RECEIPT ON A1, SECURITY LTG FIELD 1) Z/C (EMPTY)
⑰	Z/C (A1/A2 & B2) Z/C (RECEIPT ON A1, SECURITY LTG FIELD 1) Z/C (EMPTY)
⑱	Z/C (B2) Z/C (EMPTY)
⑲	Z/C (C1/C2) Z/C (EMPTY)
⑳	Z/C (C1/C2) Z/C (EMPTY)
㉑	Z/C (C1/C2) Z/C (EMPTY)
㉒	Z/C (C1/C2) Z/C (EMPTY)
㉓	Z/C (C1/C2) Z/C (EMPTY)
㉔	Z/C (C1/C2) Z/C (EMPTY)
㉕	Z/C (C1/C2) Z/C (EMPTY)
㉖	Z/C (C1/C2) Z/C (EMPTY)
㉗	Z/C (C1/C2) Z/C (EMPTY)
㉘	Z/C (C1/C2) Z/C (EMPTY)
㉙	Z/C (C1/C2) Z/C (EMPTY)
㉚	Z/C (C1/C2) Z/C (EMPTY)
㉛	Z/C (C1/C2) Z/C (EMPTY)
㉜	Z/C (C1/C2) Z/C (EMPTY)
㉝	Z/C (C1/C2) Z/C (EMPTY)
㉞	Z/C (C1/C2) Z/C (EMPTY)
㉟	Z/C (C1/C2) Z/C (EMPTY)
㊱	Z/C (C1/C2) Z/C (EMPTY)
㊲	Z/C (C1/C2) Z/C (EMPTY)
㊳	Z/C (C1/C2) Z/C (EMPTY)
㊴	Z/C (C1/C2) Z/C (EMPTY)
㊵	Z/C (C1/C2) Z/C (EMPTY)
㊶	Z/C (C1/C2) Z/C (EMPTY)
㊷	Z/C (C1/C2) Z/C (EMPTY)
㊸	Z/C (C1/C2) Z/C (EMPTY)
㊹	Z/C (C1/C2) Z/C (EMPTY)
㊺	Z/C (C1/C2) Z/C (EMPTY)
㊻	Z/C (C1/C2) Z/C (EMPTY)
㊼	Z/C (C1/C2) Z/C (EMPTY)
㊽	Z/C (C1/C2) Z/C (EMPTY)
㊾	Z/C (C1/C2) Z/C (EMPTY)
㊿	Z/C (C1/C2) Z/C (EMPTY)

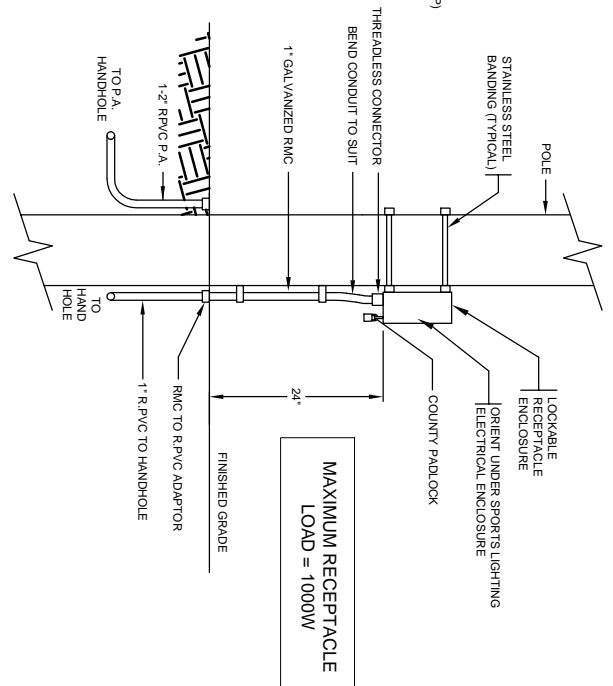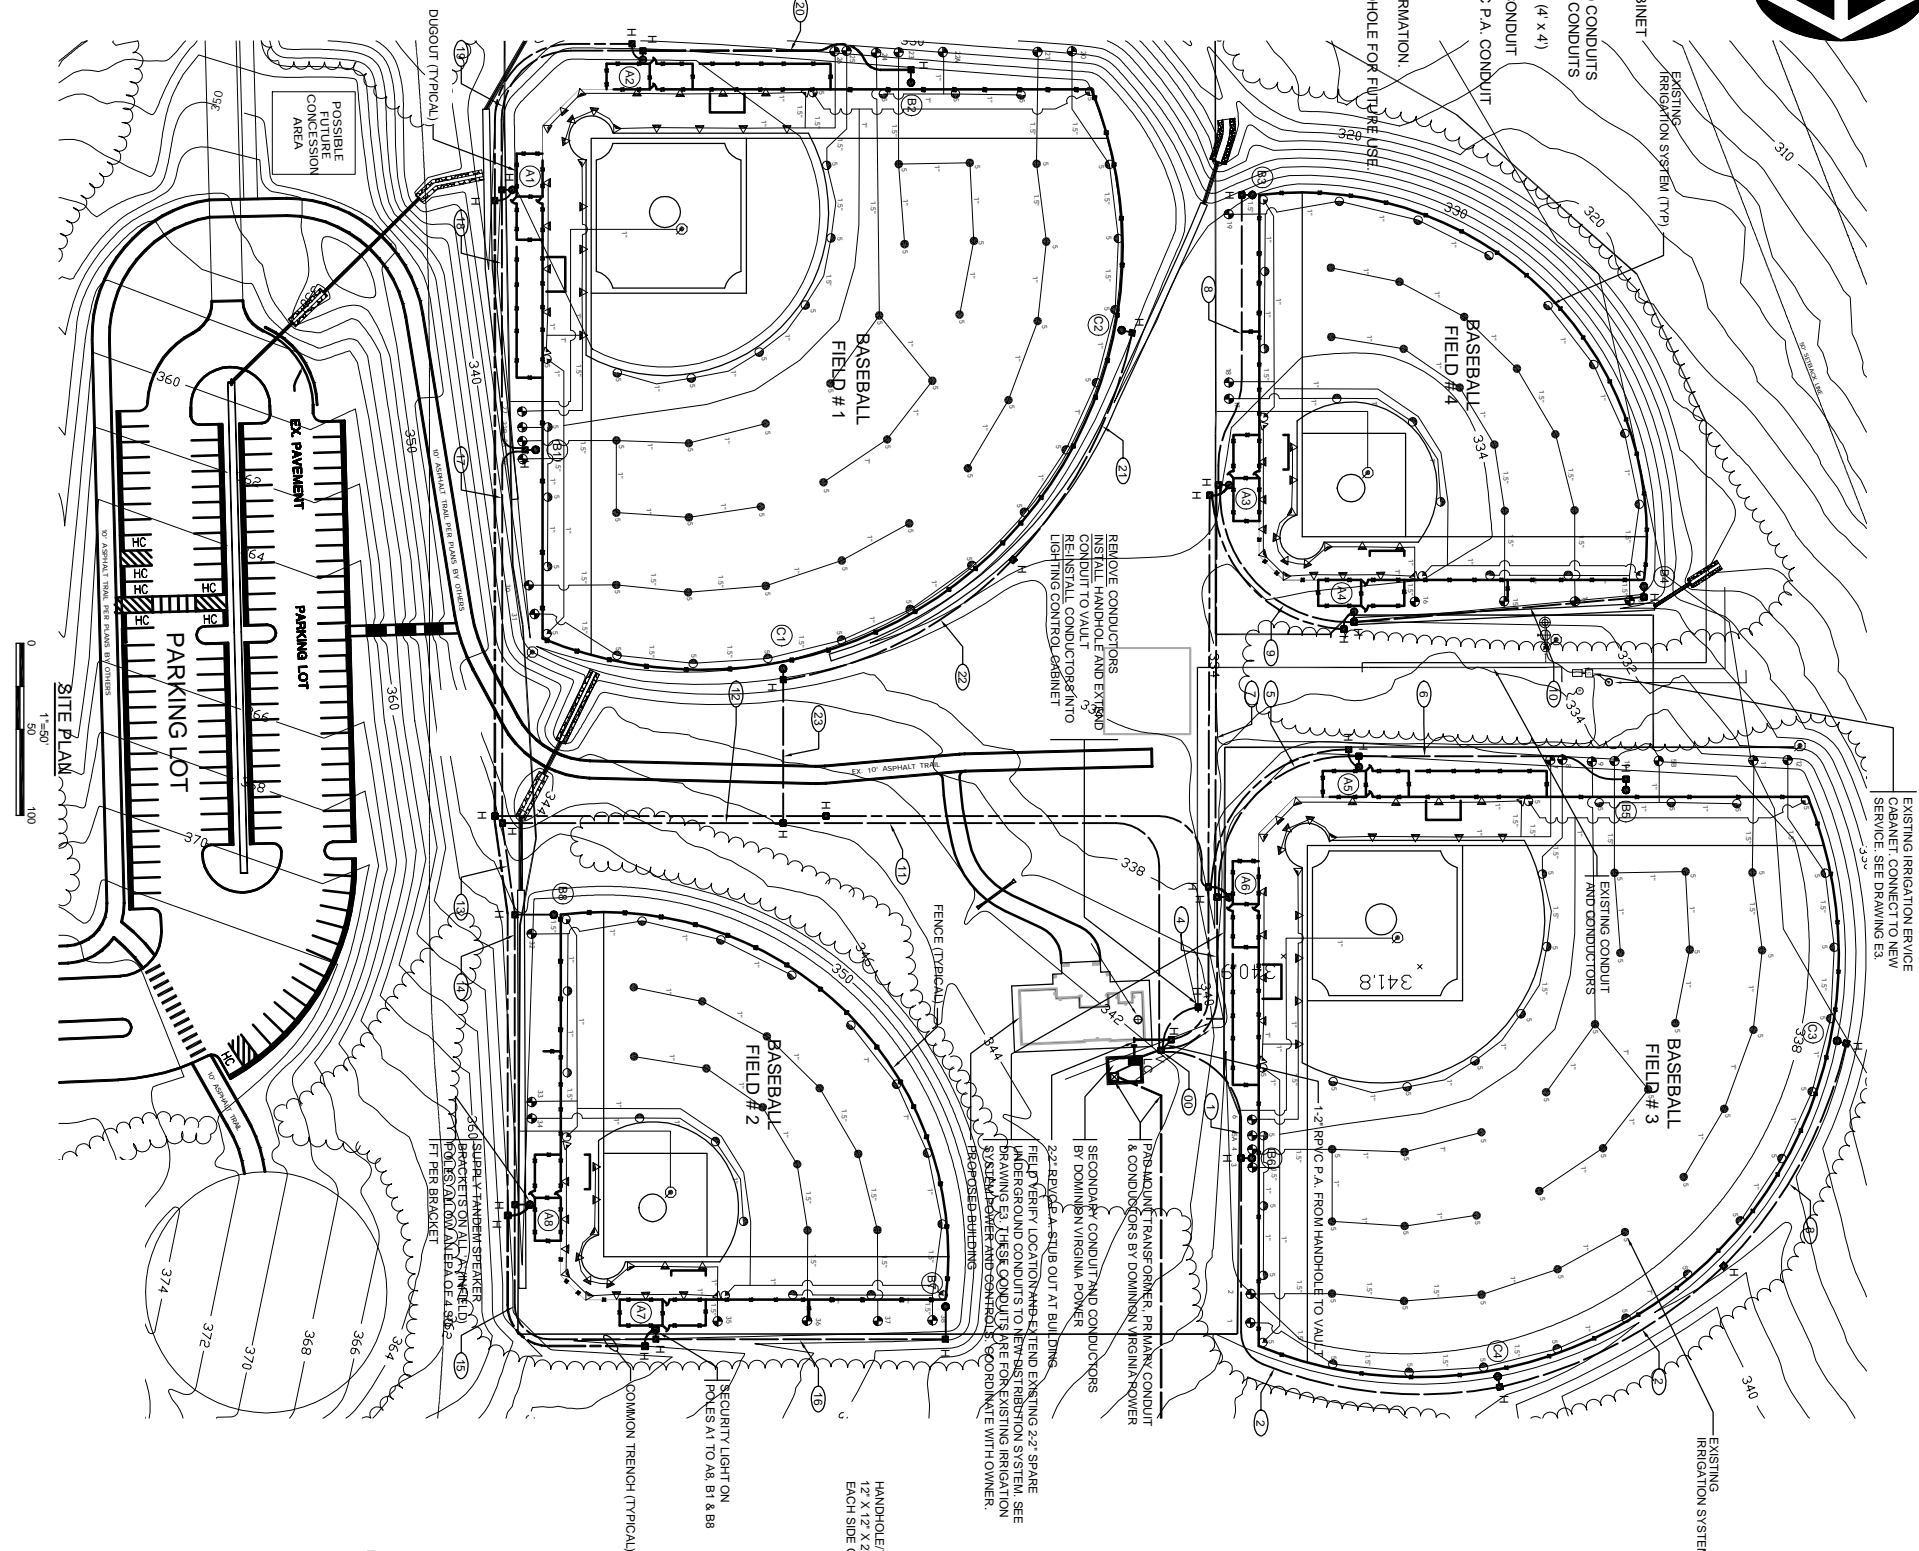

RECEPTACLE MOUNTING DETAIL (POLES)
A1, A3, A6 & A6)
N.T.S.

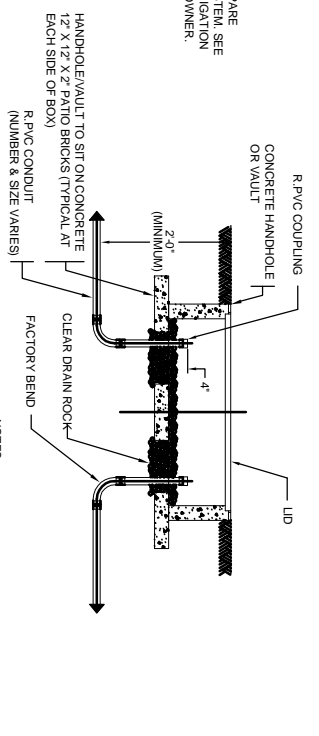

CONCRETE HANDHOLES AND VAULT
N.T.S.

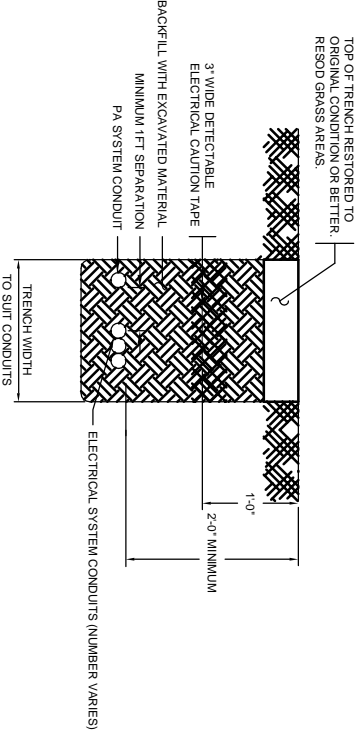

CONDUIT INSTALLATION NOTES:

- ALL UNDERGROUND CONDUITS SHALL BE SCHEDULE 40.
- ALL EMPTY CONDUITS SHALL BE CAPPED AND HAVE NYLON PULL STRING.
- ALL TRENCHES SHALL HAVE DETECTABLE ELECTRICAL CAUTION TAPE ABOVE CONDUITS.
- CONTRACTOR TO MAKE CERTAIN EXISTING BMP FACILITIES AND UNDERGROUND PIPING AND SYSTEMS SHALL BE REPAIRED AT NO COST TO OWNER.

CONDUIT INSTALLATION

N.T.S.

Scale: AS SHOWN

Drawn: R. FRASER

Checked: D. J. WONG

Date: 12-28-2005

Sheet

2 of 3

Edgar Tillett Park

Loudoun Co. Dept. of Parks, Recreation and Community Services

21561 Belmont Ridge Road

Ashburn, Virginia 20148

NO.	DATE	SUBMISSION
01-27-06	FOR BID ONLY	



DMD

DMD & Associates Ltd.

1B 19044 95A Avenue, Surrey, BC, Canada V4N 4P2

www.dmdeng.com 604/888-9010

office@dmdeng.com Fax 604/888-9011

SWSG

1821 Michael Faraday Drive

Suite 300

Reston, VA 20190

703-471-6803

A PROFESSIONAL CORPORATION

Engineering • Architecture • Construction Management